



འབྲུག་རྒྱལ་ཁབ་ཀྱི་རྒྱུ་རྩུབ་ལྷན་ཁག་
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 11-Jul-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	July 10, 2026	9:00 AM			19-Jun-26	19:30:35
						1,513.55
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.15	400kV THP - Siliguri Line - I	222.26	All Units & Feeders are in Service.
		Unit-II	177.15	400kV THP - Siliguri Line - II	220.93	
		Unit-III	187.21	400kV THP - Norbugang - IV	247.89	
		Unit-IV	185.25	400kV THP - Malbase Line - III	410.51	
		Unit-V	186.13	400kV Malbase - Siliguri Line	162.30	
		Unit-VI	187.13	400kV Norbugang-Siliguri Line	98.19	
		Total	1,110.02	Auxiliary Consumption & Transformation Losses at Generator end	0.83%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	169.90	400kV MHP - Jigmeling Line - I	235.25	400kV MHP-JLG line- II under Shutdown.
		Unit-II	167.19	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	189.82	400kV MHP - Jigmeling Line - III	243.29	
		Unit-IV	195.70	400kV MHP - Jigmeling Line - IV	243.61	
		-	-	220kV Jigmeling - BitDeer Line - I	184.11	
		-	-	220kV Jigmeling - BitDeer Line - II	166.49	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	414.18	
		-	-	400kV Jigmeling - Alipurduar Line - I	293.09	
		-	-	400kV Jigmeling - Alipurduar Line - II	292.36	
		-	-	80MVA, 220/132kV ICT - I (HV)	32.32	
		-	-	80MVA, 220/132kV ICT - II (HV)	31.96	
		-	-	132kV MHP - Yurmo Line - II	47.41	
		-	-	132kV MHP - Tintibi Line	67.43	
		-	-	132kV Gelephu - Salakati Line	-18.94	
		Total	722.61	Auxiliary Consumption & Transformation Losses at Generator end	0.29%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	166.00	400kV PHP II - Jigmeling - I	144.93	All Units & Feeders are in Service.
		Unit-II	168.61	400kV PHP II - Jigmeling - II	144.13	
		Unit-III	176.11	400kV PHP II - Alipurduar - I	373.33	
		Unit-IV	172.69	400kV PHP II - Alipurduar - II	372.70	
		Unit-V	174.53	-	-	
		Unit-VI	172.89	-	-	
		Total	1,030.83	Auxiliary Consumption & Transformation Losses at Generator end	-0.41%	
4	4 x 84 MW CHP (Chukha)	Unit-I	91.43	220kV CHP - Birpara Line - I	12.78	All Units & Feeders are in Service.
		Unit-II	91.27	220kV CHP - Birpara Line - II	12.25	
		Unit-III	89.09	220kV CHP - Gedu	95.73	
		Unit-IV	91.72	220kV CHP - Jamjee - I	78.47	
		-	-	220kV CHP - Jamjee - II	77.73	
		-	-	220kV CHP - Jamjee - III	75.07	
		-	-	220kV Malbase - Birpara Line	-10.70	
		-	-	66kV CHP - Gedu Line	10.00	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	8.07	220kV BHP - Semtokha Line	59.00	All Units & Feeders are in Service.
		Unit-II	6.64	66kV BHP - Lobeysa Line	19.75	
		Total	14.71	220kV BHP - Tsirang Line	-31.67	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	16.45	5MVA, 66/11kV TFR	0.36	All Units & Feeders are in Service.
		Unit-II	16.39	30MVA ICT, 220/66kV (HV)	4.26	
		Total	32.84	Auxiliary Consumption & Transformation Losses at Generator end	0.23%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	39.49	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang on Standby
		Unit-II	39.00	220kV DHP - Dagapela Line	77.97	
		-	-	220kV BitDeer - Dagapela Line	-32.45	
		-	-	5MVA, 220/33kV TFR	0.22	
		Total	78.49	Auxiliary Consumption & Transformation Losses at Generator end	0.38%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.47	132kV KHP - Nangkhor Line	48.36	All Units and Feeders are in Service.
		Unit-II	16.60	132kV KHP - Kilikhar Line	16.88	
		Unit-III	16.66	5MVA, 132/11kV TFR	0.31	
		Unit-IV	16.45	132kV Motanga - Rangja Line	30.07	
		Total	66.18	Auxiliary Consumption & Transformation Losses at Generator end	0.95%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	55.24	132kV NHP-MHP-I	54.83	All Units & Feeders are in Service.
		Unit-II	62.06	132kV NHP-MHP-II	61.61	
		Total	117.30	Auxiliary Consumption & Transformation Losses at Generator end	0.73%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.06	66kV SHP-Damdhum (Samtse)	0.00	Power Evacuation is through 33kV feeder.
		Unit-II	5.02	-	-	
		Total	10.08	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	22.38 MWp SSP (Sephu Solar Plant)	Inverter-1	1.68	33kV SSP-Wangdue	6.51	All inverters and Feeder in service
		Inverter-2	2.34	33kV SSP-Trongsa	6.30	
		Inverter-3	2.52	-	-	
		Inverter-4	3.36	-	-	
		Inverter-5	2.92	-	-	
		Total	12.81	Auxiliary Consumption & Transformation Losses at Generator end	-0.02%	
12	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	15.11	Unit-I under Shutdown.
		Unit-II	16.02	5MVA, 132/33kV TFR	0.66	
		Total	16.02	Auxiliary Consumption & Transformation Losses at Generator end	1.56%	
13	2 x 27 MW BSHP (Burgangchhu Small HPP)	Unit-I	0.00	132kV BSHP-Panbang	30.16	Unit I under Shutdown.
		Unit-II	27.21	132kV BSHP-Tintibi	-3.26	
		Total	27.21	Auxiliary Consumption & Transformation Losses at Generator end	1.14%	


Note: Generation-Load Summary (MW) for 10-Jul-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,602.61	1,541.99	2,060.62

Note: Generation-Load Summary (MW) for 10-Jul-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,032.78	954.00	2,078.78

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 11-Jul-2026(+ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	July 10, 2026	19:00:00			19-Jun-26	19:30:35
						1,513.55
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.23	400kV THP - Siliguri Line - I	213.51	All Feeders & Units are in Service.
		Unit-II	187.64	400kV THP - Siliguri Line - II	212.14	
		Unit-III	187.14	400kV THP - Norbugang Line - IV	243.57	
		Unit-IV	187.22	400kV THP - Malbase Line - III	444.63	
		Unit-V	186.94	400kV Malbase - Siliguri Line	146.17	
		Unit-VI	187.19	400kV Norbugang-Siliguri Line	91.16	
		Total	1,123.36	Auxiliary Consumption & Transformation Losses at Generator end	0.85%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	82.85	400kV MHP - Jigmeling Line - I	0.00	400kV MHP-JLG line I & II under Shutdown.
		Unit-II	160.16	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	193.08	400kV MHP - Jigmeling Line - III	315.51	
		Unit-IV	195.59	400kV MHP - Jigmeling Line - IV	315.31	
		-	-	220kV Jigmeling - BitDeer Line - I	171.96	
		-	-	220kV Jigmeling - BitDeer Line - II	156.25	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	415.64	
		-	-	400kV Jigmeling - Alipurdwar Line - I	247.27	
		-	-	400kV Jigmeling - Alipurdwar Line - II	245.82	
		-	-	80MVA, 220/132kV ICT - I (HV)	44.63	
		-	-	80MVA, 220/132kV ICT - II (HV)	44.14	
		-	-	132kV MHP - Yurmo Line - II	56.27	
		-	-	132kV MHP - Tintibi Line	58.61	
		-	-	132kV Gelephu - Salakati Line	-11.20	
		Total	631.68	Auxiliary Consumption & Transformation Losses at Generator end	1.75%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	156.27	400kV PHP II - Jigmeling -I	144.87	All Units & Feeders are in Service.
		Unit-II	155.20	400kV PHP II - Jigmeling -II	143.93	
		Unit-III	154.45	400kV PHP II - Alipurdwar -I	325.78	
		Unit-IV	155.38	400kV PHP II - Alipurdwar -II	325.54	
		Unit-V	155.26	-	-	
		Unit-VI	165.80	-	-	
		Total	942.36	Auxiliary Consumption & Transformation Losses at Generator end	0.24%	
4	4 x 84 MW CHP (Chhukha)	Unit-I	91.44	220kV CHP - Birpara Line - I	15.50	All Units & Feeder are in Service.
		Unit-II	91.14	220kV CHP - Birpara Line - II	15.22	
		Unit-III	88.88	220kV CHP - Gedu	67.03	
		Unit-IV	91.58	220kV CHP - Jamjee - I	86.53	
		-	-	220kV CHP - Jamjee - II	85.98	
		-	-	220kV CHP - Jamjee - III	83.00	
		-	-	220kV Malbase - Birpara Line	15.76	
		-	-	66kV CHP - Gedu Line	8.77	
		Total	363.04	Auxiliary Consumption & Transformation Losses at Generator end	0.28%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	12.01	220kV BHP - Sertokha Line	57.25	All Units and Feeders are in Service.
		Unit-II	11.95	66kV BHP - Lobeysa Line	26.15	
		Total	23.96	220kV BHP - Tsirang Line	-19.38	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	28.42	5MVA, 66/11kV TFR	0.63	
		Unit-II	20.18	30MVA ICT, 220/66kV (HV)	3.18	
		Total	48.60	Auxiliary Consumption & Transformation Losses at Generator end	-0.14%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	35.48	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang on Standby
		Unit-II	35.04	220kV DHP - Dagapela Line	70.01	
		-	-	220kV BitDeer - Dagapela Line	-24.33	
		-	-	5MVA, 220/33kV TFR	0.21	
		Total	70.52	Auxiliary Consumption & Transformation Losses at Generator end	0.43%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.68	132kV KHP - Nangkor Line	44.91	All Units & Feeders are in Service.
		Unit-II	16.48	132kV KHP - Kilikhar Line	20.32	
		Unit-III	16.67	5MVA, 132/11kV TFR	0.38	
		Unit-IV	16.52	132kV Motanga - Rangla Line	46.10	
		Total	66.35	Auxiliary Consumption & Transformation Losses at Generator end	1.12%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	62.52	132kV NHP-MHP-I	62.05	All Units & Feeders are in Service.
		Unit-II	63.47	132kV NHP-MHP-II	63.00	
		Total	125.99	Auxiliary Consumption & Transformation Losses at Generator end	0.75%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.02	66kV SHP-Damdhum (Samtse)	0.00	Interim measure: Evacuation is through 33kV System.
		Unit-II	5.06	-	-	
		Total	10.08	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	14.24	Unit-I under Shutdown.
		Unit-II	16.16	5MVA, 132/33kV TFR	1.68	
		Total	16.16	Auxiliary Consumption & Transformation Losses at Generator end	1.49%	
12	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	0.00	132kV BSHP-Panbang	43.44	Unit-I under Shutdown.
		Unit-II	27.30	132kV BSHP-Tintibi	-16.34	
		Total	27.30	Auxiliary Consumption & Transformation Losses at Generator end	0.73%	

Note: Generation-Load Summary (MW) for 10-Jul-2026 at 18:00 hrs


Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,441.40	1,552.63	1,888.77

Note: Generation-Load Summary (MW) for 10-Jul-2025, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,850.96	988.58	1,862.38

Note: Daily Energy (MUS) and Power(MW) Statistics for 10-Jul-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross- border (MW)
1	84.94	36.17	0.00	48.77	2,360.62

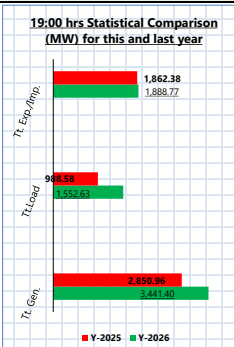

- The instantaneous load balance does not tend towards zero. This could be due to the following reasons:
 - Not all the meters are digital and not all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually.
 - The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.