



ལྷན་ཁག་དང་ལས་ཁུངས་ཀྱི་འཛིན་སྐྱོང་གི་དཔལ་ལྷན་གྱི་འཛིན་སྐྱོང་།
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 28-Jul-2026 (-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	July 27, 2026	9:00 AM			10-Jul-26	8:02:13
						1,584.59
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	185.96	400kV THP - Siliguri Line - I	220.89	All Units & Feeders are in Service.
		Unit-II	185.67	400kV THP - Siliguri Line - II	219.11	
		Unit-III	185.11	400kV THP - Norbugang - IV	243.19	
		Unit-IV	185.25	400kV THP - Malbase Line - III	430.92	
		Unit-V	185.00	400kV Malbase - Siliguri Line	156.91	
		Unit-VI	186.15	400kV Norbugang-Siliguri Line	98.11	
		Total	1,113.14	Auxiliary Consumption & Transformation Losses at Generator end	-0.09%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	197.72	400kV MHP - Jigmeling Line - I	264.19	400kV MHP-JLG Line -III on Standby.
		Unit-II	197.71	400kV MHP - Jigmeling Line - II	263.25	
		Unit-III	192.11	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	198.38	400kV MHP - Jigmeling Line - IV	257.29	
		-	-	220kV Jigmeling - BitDeer Line - I	166.62	
		-	-	220kV Jigmeling - BitDeer Line - II	150.47	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	381.82	
		-	-	400kV Jigmeling - Alipurduar Line - I	183.27	
		-	-	400kV Jigmeling - Alipurduar Line - II	181.82	
		-	-	80MVA, 220/132kV ICT - I (HV)	32.40	
		-	-	80MVA, 220/132kV ICT - II (HV)	32.10	
		-	-	132kV MHP - Yurmo Line - II	52.19	
		-	-	132kV MHP - Tintibi Line	74.00	
		-	-	132kV Gelephu - Salakati Line	-24.49	
		Total	785.92	Auxiliary Consumption & Transformation Losses at Generator end	0.50%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	149.00	400kV PHP II - Jigmeling-I	0.00	Unit-III, IV, V & VI under Shutdown. 400kV PHP II-Jigmeling line-I under Shutdown.
		Unit-II	153.47	400kV PHP II - Jigmeling-II	-32.30	
		Unit-III	0.00	400kV PHP II - Alipurduar-I	169.89	
		Unit-IV	0.00	400kV PHP II - Alipurduar-II	170.15	
		Unit-V	0.00	-	-	
		Unit-VI	0.00	-	-	
		Total	302.47	Auxiliary Consumption & Transformation Losses at Generator end	-1.74%	
4	4 x 84 MW CHP (Chukha)	Unit-I	91.54	220kV CHP - Birpara Line - I	14.29	All Units & Feeders are in Service.
		Unit-II	91.18	220kV CHP - Birpara Line - II	14.07	
		Unit-III	89.31	220kV CHP - Gedu	89.50	
		Unit-IV	91.55	220kV CHP - Jamjee - I	80.77	
		-	-	220kV CHP - Jamjee - II	79.85	
		-	-	220kV CHP - Jamjee - III	76.88	
		-	-	220kV Malbase - Birpara Line	-2.65	
		-	-	66kV CHP - Gedu Line	6.77	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	10.94	220kV BHP - Semtokha Line	44.01	All Units & Feeders are in Service.
		Unit-II	8.97	66kV BHP - Lobeysa Line	21.44	
		Total	19.91	220kV BHP - Tsirang Line	-3.37	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	20.49	5MVA, 66/11kV TFR	0.28	All Units & Feeders are in Service.
		Unit-II	20.33	30MVA ICT, 220/66kV (HV)	0.18	
		Total	40.82	Auxiliary Consumption & Transformation Losses at Generator end	-2.68%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	48.54	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line on Standby.
		Unit-II	47.01	220kV DHP - Dagapela Line	95.00	
		-	-	220kV BitDeer - Dagapela Line	-50.81	
		-	-	5MVA, 220/33kV TFR	0.20	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.58	132kV KHP - Nangkhor Line	51.84	All Units & Feeders are in Service.
		Unit-II	16.54	132kV KHP - Kilikhar Line	13.70	
		Unit-III	16.63	5MVA, 132/11kV TFR	0.35	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	65.02	132kV NHP-MHP-I	64.44	All Units & Feeders are in Service.
		Unit-II	64.91	132kV NHP-MHP-II	64.46	
		Total	129.93	Auxiliary Consumption & Transformation Losses at Generator end	0.79%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.50	66kV SHP-Damdhum (Samtse)	10.50	All Units & Feeders are in Service.
		Unit-II	5.12	-	-	
		Total	10.62	Auxiliary Consumption & Transformation Losses at Generator end	1.13%	
11	22.38 MWp SSP (Sephu Solar Plant)	Inverter-1	1.54	33kV SSP-Wangdue	5.02	All inverters and Feeders in service
		Inverter-2	1.28	33kV SSP-Trongsa	3.61	
		Inverter-3	2.18	-	-	
		Inverter-4	1.95	-	-	
		Inverter-5	1.71	-	1000.00%	
		Total	8.65	Auxiliary Consumption & Transformation Losses at Generator end	0.22%	
12	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	15.15	Unit-I under Shutdown
		Unit-II	16.05	5MVA, 132/33kV TFR	0.67	
		Total	16.05	Auxiliary Consumption & Transformation Losses at Generator end	1.43%	
13	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	0.00	132kV BSHP-Panbang	42.92	Unit I under Shutdown.
		Unit-II	27.32	132kV BSHP-Tintibi	-15.95	
		Total	27.32	Auxiliary Consumption & Transformation Losses at Generator end	1.28%	


Note: Generation-Load Summary (MW) for 27-Jul-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,980.22	1,536.17	1,444.05

Note: Generation-Load Summary (MW) for 27-Jul-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,154.10	966.81	2,187.29

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 28-Jul-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	July 27, 2026	19:00:00			10-Jul-26	8:02:13
						1,584.59
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.04	400kV THP - Siliguri Line - I	206.15	All Units & Feeders are in Service.
		Unit-II	187.69	400kV THP - Siliguri Line - II	204.85	
		Unit-III	187.09	400kV THP - Norbugang Line - IV	244.78	
		Unit-IV	187.22	400kV THP - Malbase Line - III	456.60	
		Unit-V	186.92	400kV Malbase - Siliguri Line	138.90	
		Unit-VI	187.13	400kV Norbugang-Siliguri Line	83.42	
		Total	1,123.09	Auxiliary Consumption & Transformation Losses at Generator end	0.95%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	197.90	400kV MHP - Jigmeling Line - I	263.24	400kV MHP-JLG Line -III on Standby.
		Unit-II	197.72	400kV MHP - Jigmeling Line - II	262.66	
		Unit-III	190.11	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	198.27	400kV MHP - Jigmeling Line - IV	256.24	
		-	-	220kV Jigmeling - BitDeer Line - I	166.77	
		-	-	220kV Jigmeling - BitDeer Line - II	151.37	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	404.36	
		-	-	400kV Jigmeling - Aliparduar Line - I	139.64	
		-	-	400kV Jigmeling - Aliparduar Line - II	138.91	
		-	-	80MVA, 220/132kV ICT - I (HV)	43.95	
		-	-	80MVA, 220/132kV ICT - II (HV)	43.57	
		-	-	132kV MHP - Yumo Line - II	56.72	
		-	-	132kV MHP - Tintibi Line	68.00	
		-	-	132kV Gelephu - Salakati Line	-23.04	
		Total	784.00	Auxiliary Consumption & Transformation Losses at Generator end	0.77%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	0.00	400kV PHP II - Jigmeling -I	0.00	All Units & 400kV PHP II-Jigmeling-I & 400kV PHP II-Aliparduar-I under Shutdown
		Unit-II	0.00	400kV PHP II - Jigmeling -II	-92.22	
		Unit-III	0.00	400kV PHP II - Aliparduar-I	0.00	
		Unit-IV	0.00	400kV PHP II - Aliparduar -II	92.32	
		Unit-V	0.00	-	-	
		Unit-VI	0.00	-	-	
		Total	0.00	Auxiliary Consumption & Transformation Losses at Generator end	0.00%	
4	4 x 84 MW CHP (Chhukha)	Unit-I	91.29	220kV CHP - Birpara Line - I	13.90	All Units & Feeders are in Service.
		Unit-II	91.09	220kV CHP - Birpara Line - II	13.80	
		Unit-III	89.26	220kV CHP - Gedu	54.93	
		Unit-IV	91.54	220kV CHP - Jamjee - I	93.07	
		-	-	220kV CHP - Jamjee - II	92.09	
		-	-	220kV CHP - Jamjee - III	89.08	
		-	-	220kV Malbase - Birpara Line	23.84	
		-	-	66kV CHP - Gedu Line	5.87	
		Total	363.18	Auxiliary Consumption & Transformation Losses at Generator end	0.12%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	10.71	220kV BHP - Sertokha Line	33.05	All Units and Feeders are in Service.
		Unit-II	8.69	66kV BHP - Lobeysa Line	24.90	
		Total	19.40	220kV BHP - Tsirang Line	0.00	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	19.65	5MVA, 66/11kV TFR	0.63	
		Unit-II	19.64	30MVA ICT, 220/66kV (HV)	5.10	
		Total	39.29	Auxiliary Consumption & Transformation Losses at Generator end	0.19%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	47.56	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line on Standby.
		Unit-II	46.03	220kV DHP - Dagapela Line	92.59	
		-	-	220kV BitDeer - Dagapela Line	-46.61	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	93.59	Auxiliary Consumption & Transformation Losses at Generator end	0.85%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.49	132kV KHP - Nangkor Line	48.60	All Units & Feeders are in Service.
		Unit-II	16.56	132kV KHP - Kilikhar Line	16.59	
		Unit-III	16.61	5MVA, 132/11kV TFR	0.44	
		Unit-IV	16.52	132kV Motanga - Rangla Line	44.41	
		Total	66.18	Auxiliary Consumption & Transformation Losses at Generator end	0.83%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	64.83	132kV NHP-MHP-I	64.43	All Units & Feeders are in Service.
		Unit-II	64.89	132kV NHP-MHP-II	64.44	
		Total	129.72	Auxiliary Consumption & Transformation Losses at Generator end	0.66%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	6.09	66kV SHP-Damdhum (Samtse)	12.09	All Units & Feeders are in Service.
		Unit-II	6.13	-	-	
		Total	12.22	Auxiliary Consumption & Transformation Losses at Generator end	1.06%	
11	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	14.37	Unit-I under Shutdown.
		Unit-II	16.05	5MVA, 132/33kV TFR	1.44	
		Total	16.05	Auxiliary Consumption & Transformation Losses at Generator end	1.50%	
12	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	0.00	132kV BSHP-Panbang	56.65	Unit-I under Shutdown.
		Unit-II	27.34	132kV BSHP-Tintibi	-29.64	
		Total	27.34	Auxiliary Consumption & Transformation Losses at Generator end	1.21%	

Note: Generation-Load Summary (MW) for 27-Jul-2026 at 18:00 hrs


Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,674.06	1,596.96	1,077.10

Note: Generation-Load Summary (MW) for 27-Jul-2025, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,154.14	1,006.94	2,147.20

Note: Daily Energy (MUS) and Power(MW) Statistics for 27-Jul-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross- border (MW)
1	71.13	36.66	0.00	34.47	2,240.22

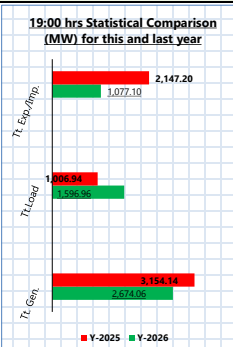

- The Instantaneous load balance does not tend towards zero. This could be due to the following reasons:
 - Not all the meters are digital and not all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually. ii) The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.