



ལྷན་ཁྲིམས་དང་འཕུལ་གྲུབ་ལྷན་ཁྲིམས་ཀྱི་འཕུལ་གྲུབ་ལྷན་ཁྲིམས་
 Ministry of Energy and Natural Resources
 Royal Government of Bhutan
Bhutan Power System Operator
 Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 27-Dec-2025(+ve:import, +ve:export)

Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time	Load
	December 26, 2025	9:00 AM			08-Nov-25	19:03:00	1,477.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks	
1	6 x 170MW THP	Unit-I	160.48	400kV THP - Siliguri Line - I	245.20	Unit-II & VI under Shutdown (Annual Maintenance). Unit-IV on Standby. 400kV THP-Malbase Line under shutdown.	
		Unit-II	0.00	400kV THP - Siliguri Line - II	245.12		
		Unit-III	165.38	400kV THP - Siliguri Line - IV	0.00		
		Unit-IV	0.00	400kV THP - Malbase Line - III	0.00		
		Unit-V	167.86	400kV Malbase - Siliguri Line	-259.60		
		Unit-VI	0.00	-	-		
		Total	493.72	Auxiliary Consumption & Transformation Losses at Generator end	0.69%		
2	4 x 180MW MHP	Unit-I	0.00	400kV MHP - Jigmeling Line - I	106.26	Unit-IV on Standby. Unit-I under Shutdown (AMP). 400kV MHP-JIG Line - II and IV kept on Standby as other two lines can cater the load.	
		Unit-II	150.18	400kV MHP - Jigmeling Line - II	0.00		
		Unit-III	151.47	400kV MHP - Jigmeling Line - III	106.81		
		Unit-IV	0.00	400kV MHP - Jigmeling Line - IV	0.00		
		-	-	220kV Jigmeling - BitDeer Line - I	198.36		
		-	-	220kV Jigmeling - BitDeer Line - II	203.16		
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	430.55		
		-	-	400kV Jigmeling - Alipurduar Line - I	1.46		
		-	-	400kV Jigmeling - Alipurduar Line - II	2.18		
		-	-	80MVA, 220/132kV ICT - I (HV)	-15.04		
		-	-	80MVA, 220/132kV ICT - II (HV)	-14.84		
		-	-	132kV MHP - Yurno Line - II	63.39		
		-	-	132kV MHP - Tintibi Line	63.44		
		-	-	132kV Gelephu - Salakati Line	-48.16		
		Total	301.65	Auxiliary Consumption & Transformation Losses at Generator end	0.48%		
3	6 x 170MW PHP-II	Unit-I	0.00	400kV PHP II - Jigmeling - I	111.73	Unit-I, Unit-II & Unit-III under Shutdown (Annual Maintenance). Unit-V on Standby.	
		Unit-II	0.00	400kV PHP II - Jigmeling - II	76.14		
		Unit-III	0.00	400kV PHP II - Alipurduar - I	56.75		
		Unit-IV	165.01	400kV PHP II - Alipurduar - II	57.52		
		Unit-V	0.00	-	-		
		Unit-VI	170.08	-	-		
		Total	335.09	Auxiliary Consumption & Transformation Losses at Generator end	9.83%		
4	4 x 84MW CHP	Unit-I	0.00	220kV CHP - Birpara Line - I	-78.66	Unit-I under Shutdown (Upgradation works on common Emergency Cooling Water pipelines). Unit-II under Shutdown(Annual Maintenance).	
		Unit-II	0.00	220kV CHP - Birpara Line - II	-78.24		
		Unit-III	75.42	220kV CHP - Gedu	38.28		
		Unit-IV	74.26	220kV CHP - Jamjee - I	88.36		
		-	-	220kV CHP - Jamjee - II	87.45		
		-	-	220kV CHP - Jamjee - III	84.45		
		-	-	220kV Malbase - Birpara Line	-115.00		
		-	-	66kV CHP - Gedu Line	7.22		
Total	149.68	Auxiliary Consumption & Transformation Losses at Generator end	0.55%				
5	2 x 12MW BHP (U/S)	Unit-I	8.53	220kV BHP - Semtokha Line	70.85	BHP L/S Unit-II under Shutdown(AMP). BHP U/S Unit-II under Shutdown.	
		Unit-II	0.00	66kV BHP - Lobeysa Line	19.16		
		Total	8.53	220kV BHP - Tsirang Line	-65.22		
6	2 x 20MW BHP (L/S)	Unit-I	16.42	5MVA, 66/11kV TFR	0.35		
		Unit-II	0.00	30MVA ICT, 220/66kV (HV)	11.36		
		Total	16.42	Auxiliary Consumption & Transformation Losses at Generator end	-0.76%		
7	2 x 63MW DHP	Unit-I	0.00	220kV DHP - Tsirang Line	0.00	Total Plant Shutdown from 10:27 hrs (09.10.2025) due to Seepage in HRC .	
		Unit-II	0.00	220kV DHP - Dagapela Line	0.00		
		-	-	220kV BitDeer - Dagapela Line	22.00		
		-	-	5MVA, 220/33kV TFR	-		
		Total	0.00	Auxiliary Consumption & Transformation Losses at Generator end	0.00%		
8	4 x 15MW KHP	Unit-I	0.00	132kV KHP - Nangkor Line	10.75	Unit-I on Standby. Unit-III under Shutdown.	
		Unit-II	12.64	132kV KHP - Kilikhar Line	14.00		
		Unit-III	0.00	5MVA, 132/11kV TFR	0.39		
		Unit-IV	12.69	132kV Motanga - Rangia Line	-19.66		
		Total	25.33	Auxiliary Consumption & Transformation Losses at Generator end	0.75%		
9	2 x 59MW NHP	Unit-I	0.00	132kV NHP-MHP-I	0.00	Unit-I under Shutdown (Annual Maintenance) 132kV NHP-MHP line I under ideal charge at NHP end.	
		Unit-II	40.02	132kV NHP-MHP-II	39.69		
		Total	40.02	Auxiliary Consumption & Transformation Losses at Generator end	0.82%		
10	2 x 9MW SHP	Unit-I	0.00	66kV SHP-Damdhum (Samtse)	0.00	Unit-I on Standby Interim measure: Evacuation is through 33kV System.	
		Unit-II	6.19	-	-		
		Total	6.19	Auxiliary Consumption & Transformation Losses at Generator end	100.00%		
11	17.38 MWp Sephu (Solar)	Inverter-1	1.44	33kV SSP-Wangdue	6.49	All Inverters and Feeders in Service.	
		Inverter-2	2.58	33kV SSP-Trongsas	5.93		
		Inverter-3	2.47	-	-		
		Inverter-4	3.27	-	-		
		Inverter-5	2.67	-	-		
		Total	12.43	Auxiliary Consumption & Transformation Losses at Generator end	0.06%		

Note: Generation-Load Summary (MW) for 26-Dec-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,389.06	1,380.15	8.91

Note: Generation-Load Summary (MW) for 26-Dec-24 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,002.23	965.17	37.06

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 27-Dec-2025(-ve:import, +ve:export)							
Report	Date	Time	National Coincidental Peak Load (MW)		Date	Time	Load
Details	December 26, 2025	18:00:00			08-Nov-25	19:03:00	1,477.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks	
1	6 x 170MW THP	Unit-I	172.52	400kV THP - Siliguri Line - I	244.71	Unit-IV,V,VI under Shutdown (Annual Maintenance). 400kV THP_SIL_Line-IV on Standby. 400kV THP-Malbase Line under Shutdown.	
		Unit-II	170.76	400kV THP - Siliguri Line - II	245.43		
		Unit-III	149.97	400kV THP - Siliguri Line - IV	0.00		
		Unit-IV	0.00	400kV THP - Malbase Line - III	0.00		
		Unit-V	0.00	400kV Malbase - Siliguri Line	-273.46		
		Unit-VI	0.00	-	-		
		Total	493.25	Auxiliary Consumption & Transformation Losses at Generator end	0.63%		
2	4 x 180MW MHP	Unit-I	0.00	400kV MHP - Jigmeling Line - I	109.75	Unit-I under Shutdown (Annual Maintenance). Unit-IV on Standby. 400kV MHP-JIG Line - II and IV kept on Standby as other two Lines can cater the load.	
		Unit-II	164.65	400kV MHP - Jigmeling Line - II	0.00		
		Unit-III	165.62	400kV MHP - Jigmeling Line - III	110.39		
		Unit-IV	0.00	400kV MHP - Jigmeling Line - IV	0.00		
		-	-	220kV Jigmeling - BitDeer Line - I	197.90		
		-	-	220kV Jigmeling - BitDeer Line - II	208.75		
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	440.00		
		-	-	400kV Jigmeling - Alipurduar Line - I	7.27		
		-	-	400kV Jigmeling - Alipurduar Line - II	6.55		
		-	-	80MVA, 220/132kV ICT - I (HV)	-17.18		
		-	-	80MVA, 220/132kV ICT - II (HV)	-17.01		
		-	-	132kV MHP - Yurmo Line - II	70.76		
		-	-	132kV MHP - Tintibi Line	65.98		
		-	-	132kV Gelephu - Salakati Line	-52.94		
		Total	330.27	Auxiliary Consumption & Transformation Losses at Generator end	0.37%		
3	6 x 170MW PHP-II	Unit-I	0.00	400kV PHP II - Jigmeling -I	119.20	Unit-I & II under Shutdown (Annual Maintenance). Unit-III under shutdown for runner inspection. Unit-V on Standby.	
		Unit-II	0.00	400kV PHP II - Jigmeling -II	117.30		
		Unit-III	0.00	400kV PHP II - Alipurduar -I	66.79		
		Unit-IV	182.90	400kV PHP II - Alipurduar -II	67.13		
		Unit-V	0.00	-	-		
		Unit-VI	185.51	-	-		
		Total	368.41	Auxiliary Consumption & Transformation Losses at Generator end	-0.55%		
4	4 x 84MW CHP	Unit-I	0.00	220kV CHP - Birpara Line - I	-80.37	Unit-I under Shutdown (Upgradation works on common Emergency Cooling Water pipelines). Unit-II under Shutdown(Annual Maintenance).	
		Unit-II	0.00	220kV CHP - Birpara Line - II	-79.55		
		Unit-III	85.33	220kV CHP - Gedu	41.84		
		Unit-IV	84.34	220kV CHP - Jamjee - I	94.60		
		-	-	220kV CHP - Jamjee - II	93.81		
		-	-	220kV CHP - Jamjee - III	90.56		
		-	-	220kV Malbase - Birpara Line	-119.36		
		-	-	66kV CHP - Gedu Line	7.94		
Total	169.67	Auxiliary Consumption & Transformation Losses at Generator end	0.50%				
5	2 x 12MW BHP (U/S)	Unit-I	2.50	220kV BHP - Sertokha Line	80.02	L/S Unit-II on Standby.	
		Unit-II	4.10	66kV BHP - Lobeyssa Line	25.12		
		Total	6.60	220kV BHP - Tsirang Line	-82.44		
6	2 x 20MW BHP (L/S)	Unit-I	16.51	5MVA, 66/11kV TFR	0.59		
		Unit-II	0.00	30MVA ICT, 220/66kV (HV)	17.61		
		Total	16.51	Auxiliary Consumption & Transformation Losses at Generator end	-0.78%		
7	2 x 63MW DHP	Unit-I	0.00	220kV DHP - Tsirang Line	0.00	Total Plant Shutdown from 10:27 hrs (09.10.2025) due to Seepage in HRC .	
		Unit-II	0.00	220kV DHP - Dagapela Line	0.00		
		-	-	220kV BitDeer - Dagapela Line	22.79		
		-	-	5MVA, 220/33kV TFR	-		
Total	0.00	Auxiliary Consumption & Transformation Losses at Generator end	0.00%				
8	4 x 15MW KHP	Unit-I	12.61	132kV KHP - Nangkor Line	8.37	Unit-IV on Standby. Unit-III under Shutdown(AMP).	
		Unit-II	12.63	132kV KHP - Kilikhar Line	16.18		
		Unit-III	0.00	5MVA, 132/11kV TFR	0.42		
		Unit-IV	0.00	132kV Motanga - Rangia Line	-21.49		
		Total	25.24	Auxiliary Consumption & Transformation Losses at Generator end	1.07%		
9	2 x 59MW NHP	Unit-I	0.00	132kV NHP-MHP-I	0.00	Unit-I under Shutdown. 132kV NHP-MHP line I under ideal charge at NHP end.	
		Unit-II	27.98	132kV NHP-MHP-II	27.83		
		Total	27.98	Auxiliary Consumption & Transformation Losses at Generator end	0.54%		
10	2 x 9MW SHP	Unit-I	0.00	66kV SHP-Damdhum (Samtse)	0.00	Unit-I on Standby. Interim measure: Evacuation is through 33kV System.	
		Unit-II	6.09	-	-		
		Total	6.09	Auxiliary Consumption & Transformation Losses at Generator end	100.00%		

Note: Generation-Load Summary (MW) for 26-Dec-2025 at 18:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,444.02	1,433.31	10.71


Note: Generation-Load Summary (MW) for 26-Dec-2024, at 18:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,036.17	998.99	37.72

Note: Daily Energy (MUs) and Power(MW) Statistics for 26-Dec-2025

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross-border (MW)
1	20.41	32.54	12.13	0.00	-913.92

19:00 hrs Statistical Comparison (MW) for this and last year

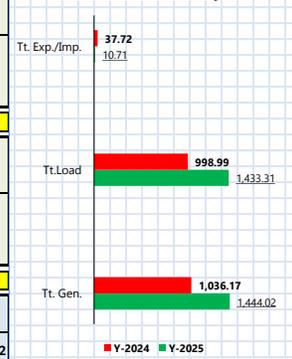

- The Instantaneous load balance does not tend towards zero. This could be due to the following reasons:
 - Not all the meters are digital and nor are all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually. ii) The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.