



འབྲུག་རྒྱལ་ཁབ་ལ་འཕྲིན་ལྷན་ཁག་གི་འཕུལ་གྲུབ་ལྟུང་།
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 06-Feb-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	February 5, 2026	9:00 AM			08-Nov-25	19:03:00
						1,477.00
Sl.No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170MW THP	Unit-I	183.87	400kV THP - Siliguri Line - I	0.00	Unit- IV,V & VI under Shutdown (Annual Maintenance). 400kV THP_SIL line I on Standby.
		Unit- II	184.21	400kV THP - Siliguri Line - II	77.88	
		Unit- III	182.37	400kV THP - Norbugang - IV	151.03	
		Unit- IV	0.00	400kV THP - Malbase Line - III	321.42	
		Unit- V	0.00	400kV Malbase - Siliguri Line	16.73	
		Unit- VI	0.00	400kV Norbugang-Siliguri Line	-4.88	
		Total	550.46	Auxiliary Consumption & Transformation Losses at Generator end	0.02%	
2	4 x 180MW MHP	Unit-I	171.77	400kV MHP - Jigmeling Line - I	0.00	Unit-IV under Shutdown (Annual Maintenance). Unit-III under Shutdown. 400kV MHP-JIG Line - I under Shutdown & line III on Standby as other two lines can cater the load.
		Unit-II	179.84	400kV MHP - Jigmeling Line - II	116.48	
		Unit-III	0.00	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	0.00	400kV MHP - Jigmeling Line - IV	117.43	
		-	-	220kV Jigmeling - BitDeer Line - I	198.69	
		-	-	220kV Jigmeling - BitDeer Line - II	200.31	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	452.00	
		-	-	400kV Jigmeling - Alipurduar Line - I	-8.73	
		-	-	400kV Jigmeling - Alipurduar Line - II	-9.46	
		-	-	80MVA, 220/132kV ICT - I (HV)	-27.60	
		-	-	80MVA, 220/132kV ICT - II (HV)	-27.30	
		-	-	132kV MHP - Yurmo Line - II	66.70	
		-	-	132kV MHP - Tintibi Line	71.63	
		-	-	132kV Gelephu - Salakati Line	-49.46	
		Total	351.61	Auxiliary Consumption & Transformation Losses at Generator end	0.31%	
3	6 x 170MW PHP-II	Unit-I	0.00	400kV PHP II - Jigmeling -I	204.69	Unit-I, II & IV under Shutdown (Annual Maintenance). 400kV PHP II-Jigmeling-II & 400kV PHP II-Alipurduar line-I on standby. Unit-III on Standby.
		Unit- II	0.00	400kV PHP II - Jigmeling -II	0.00	
		Unit- III	0.00	400kV PHP II - Alipurduar -I	0.00	
		Unit- IV	0.00	400kV PHP II - Alipurduar -II	95.73	
		Unit- V	150.62	-	-	
		Unit- VI	149.47	-	-	
		Total	300.09	Auxiliary Consumption & Transformation Losses at Generator end	-0.11%	
4	4 x 84MW CHP	Unit- I	0.00	220kV CHP - Birpara Line - I	-73.92	Unit-I & II under Shutdown (Annual Maintenance). 220kV CHP-Birpara Line-II under Shutdown.
		Unit- II	0.00	220kV CHP - Birpara Line - II	0.00	
		Unit- III	70.67	220kV CHP - Gedu	-106.72	
		Unit- IV	69.84	220kV CHP - Jamjee - I	107.46	
		-	-	220kV CHP - Jamjee - II	106.53	
		-	-	220kV CHP - Jamjee - III	102.94	
		-	-	220kV Malbase - Birpara Line	-20.00	
		-	-	66kV CHP - Gedu Line	3.50	
		Total	140.51	Auxiliary Consumption & Transformation Losses at Generator end	0.51%	
5	2 x 12MW BHP (U/S)	Unit- I	5.80	220kV BHP - Semtokha Line	34.70	L/S Unit-I under AMP. U/S Unit-II under Shutdown.
		Unit- II	0.00	66kV BHP - Lobeysa Line	19.33	
		Total	5.80	220kV BHP - Tsirang Line	-36.50	
6	2 x 20MW BHP (L/S)	Unit- I	0.00	5MVA, 66/11kV TFR	0.67	
		Unit- II	12.10	30MVA ICT, 220/66kV (HV)	14.24	
		Total	12.10	Auxiliary Consumption & Transformation Losses at Generator end	-1.68%	
7	2 x 63MW DHP	Unit-I	0.00	220kV DHP - Tsirang Line	0.03	Total Plant Shutdown from 10:27 hrs (09.10.2025) due to Seepage in HRC .
		Unit-II	0.00	220kV DHP - Dagapela Line	0.00	
		-	-	220kV BitDeer - Dagapela Line	58.15	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	0.00	Auxiliary Consumption & Transformation Losses at Generator end	0.00%	
8	4 x 15MW KHP	Unit- I	0.00	132kV KHP - Nangkhor Line	9.82	Unit-II under AMP. Unit-I under Shutdown.
		Unit-II	0.00	132kV KHP - Kilikhar Line	13.77	
		Unit- III	12.17	5MVA, 132/11kV TFR	0.42	
		Unit- IV	12.24	132kV Motanga - Rangja Line	-5.67	
		Total	24.41	Auxiliary Consumption & Transformation Losses at Generator end	1.63%	
9	2 x 59MW NHP	Unit-I	0.00	132kV NHP-MHP-I	0.00	Unit I under Shutdown. 132kV NHP-MHP line I under ideal charge at NHP end.
		Unit-II	21.99	132kV NHP-MHP-II	21.73	
		Total	21.99	Auxiliary Consumption & Transformation Losses at Generator end	1.18%	
10	2 x 9MW SHP	Unit- I	4.00	66kV SHP-Damdhum (Samtse)	0.00	Unit-II on Standby. Interim measure: Evacuation is through 33kV System.
		Unit- II	0.00	-	-	
		Total	4.00	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	17.38 MWp Sephu (Solar)	Inverter-1	1.46	33kV SSP-Wangdue	6.54	Inverter 4 & 5 on Standby 33kV SSP-Trongsa Shutdown availed by BPC.
		Inverter-2	2.58	33kV SSP-Trongsa	0.00	
		Inverter-3	2.50	-	-	
		Inverter-4	0.00	-	-	
		Inverter-5	0.00	-	-	
		Total	6.54	Auxiliary Consumption & Transformation Losses at Generator end	-0.08%	


Note: Generation-Load Summary (MW) for 05-Feb-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,417.50	1,399.28	18.22

Note: Generation-Load Summary (MW) for 05-Feb-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	897.65	870.78	26.87

09:00 hrs Statistical Comparison
(MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 06-Feb-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	February 5, 2026	18:00:00			08-Nov-25	19:03:00
						1,477.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170MW THP	Unit-I	184.00	400kV THP - Siliguri Line - I	0.00	Unit- IV,V & VI under Shutdown (Annual Maintenance). 400kV THP_SIL line I on Standby.
		Unit- II	183.00	400kV THP - Siliguri Line - II	75.48	
		Unit- III	183.00	400kV THP - Norbugang Line - IV	169.00	
		Unit- IV	0.00	400kV THP - Malbase Line - III	305.07	
		Unit- V	0.00	400kV Malbase - Siliguri Line	19.63	
		Unit- VI	0.00	400kV Norbugang-Siliguri Line	-17.25	
		Total	550.00	Auxiliary Consumption & Transformation Losses at Generator end	0.08%	
2	4 x 180MW MHP	Unit-I	174.76	400kV MHP - Jigmeling Line - I	0.00	Unit-III under Shutdown. Unit-IV under AMP. 400kV MHP-JLG Line - III on Standby. 400kV MHP-JLG line - I under Shutdown.
		Unit-II	175.68	400kV MHP - Jigmeling Line - II	112.45	
		Unit-III	0.00	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	0.00	400kV MHP - Jigmeling Line - IV	112.94	
		-	-	220kV Jigmeling - BitDeer Line - I	198.84	
		-	-	220kV Jigmeling - BitDeer Line - II	204.80	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	464.00	
		-	-	400kV Jigmeling - Alipurduar Line - I	7.27	
		-	-	400kV Jigmeling - Alipurduar Line - II	8.00	
		-	-	80MVA, 220/132kV ICT - I (HV)	-30.18	
		-	-	80MVA, 220/132kV ICT - II (HV)	-29.90	
		-	-	132kV MHP - Yurmo Line - II	68.55	
		-	-	132kV MHP - Tintibi Line	76.96	
		-	-	132kV Gelephu - Salakati Line	-53.85	
		Total	350.44	Auxiliary Consumption & Transformation Losses at Generator end	0.41%	
3	6 x 170MW PHP-II	Unit-I	0.00	400kV PHP II - Jigmeling -I	227.80	Unit-I, II & IV under Shutdown (Annual Maintenance). Unit-III on Standby. 400kV PHPII - JLG-II & 400kV PHPII - ALI-I on Standby.
		Unit- II	0.00	400kV PHP II - Jigmeling -II	0.00	
		Unit- III	0.00	400kV PHP II - Alipurduar-I	0.00	
		Unit- IV	0.00	400kV PHP II - Alipurduar -II	108.56	
		Unit- V	169.64	-	-	
		Unit- VI	165.31	-	-	
		Total	334.95	Auxiliary Consumption & Transformation Losses at Generator end	-0.42%	
4	4 x 84MW CHP	Unit-I	0.00	220kV CHP - Birpara Line - I	-76.51	Unit-I & II under Shutdown (Annual Maintenance). 220kV CHP_Birpara Line II under Shutdown.
		Unit- II	0.00	220kV CHP - Birpara Line - II	0.00	
		Unit- III	65.72	220kV CHP - Gedu	-126.72	
		Unit- IV	64.69	220kV CHP - Jamjee - I	113.13	
		-	-	220kV CHP - Jamjee - II	111.50	
		-	-	220kV CHP - Jamjee - III	110.00	
		-	-	220kV Malbase - Birpara Line	-8.00	
		-	-	66kV CHP - Gedu Line	1.33	
		Total	130.41	Auxiliary Consumption & Transformation Losses at Generator end	-1.78%	
5	2 x 12MW BHP (U/S)	Unit-I	5.70	220kV BHP - Semotha Line	38.92	L/S Unit-I under AMP. U/S unit-II under Shutdown.
		Unit- II	0.00	66kV BHP - Lobeysa Line	23.46	
		Total	5.70	220kV BHP - Tsirang Line	-45.51	
		Unit-I	0.00	5MVA, 66/11kV TFR	0.97	
6	2 x 20MW BHP (L/S)	Unit- II	12.10	30MVA ICT, 220/66kV (HV)	18.69	
		Total	12.10	Auxiliary Consumption & Transformation Losses at Generator end	-0.22%	
7	2 x 63MW DHP	Unit-I	0.00	220kV DHP - Tsirang Line	0.03	Total Plant Shutdown from 10:27 hrs (09.10.2025) due to Seepage in HRC .
		Unit-II	0.00	220kV DHP - Dagapela Line	0.00	
		-	-	220kV BitDeer - Dagapela Line	57.00	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	0.00	Auxiliary Consumption & Transformation Losses at Generator end	0.00%	
8	4 x 15MW KHP	Unit-I	0.00	132kV KHP - Nangkor Line	1.26	Unit-IV on Standby. Unit-II under Shutdown (AMP). Unit-I under Shutdown.
		Unit-II	0.00	132kV KHP - Kilikhar Line	13.38	
		Unit- III	15.37	5MVA, 132/11kV TFR	0.48	
		Unit- IV	0.00	132kV Motanga - Rangia Line	-11.79	
		Total	15.37	Auxiliary Consumption & Transformation Losses at Generator end	1.64%	
9	2 x 59MW NHP	Unit-I	0.00	132kV NHP-MHP-I	0.00	Unit I under Shutdown 132kV NHP-MHP line I under ideal charge at NHP end.
		Unit-II	22.01	132kV NHP-MHP-II	21.90	
		Total	22.01	Auxiliary Consumption & Transformation Losses at Generator end	0.50%	
10	2 x 9MW SHP	Unit-I	4.00	66kV SHP-Damdhum (Samtse)	0.00	Unit-II on Standby. Interim measure: Evacuation is through 33kV System.
		Unit- II	0.00	-	-	
		Total	4.00	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	

Note: Generation-Load Summary (MW) for 05-Feb-2026 at 18:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,424.98	1,374.24	50.74


Note: Generation-Load Summary (MW) for 05-Feb-2025, at 18:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	935.13	907.96	27.17

Note: Daily Energy (MUs) and Power(MW) Statistics for 05-Feb-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross-border (MW)
1	14.55	32.08	17.53	0.35	-986.21

19:00 hrs Statistical Comparison (MW) for this and last year

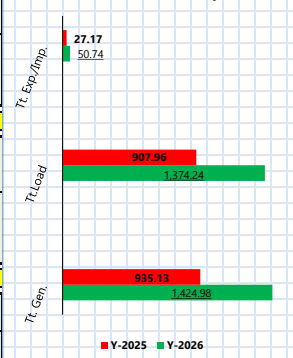

- The instantaneous load balance does not tend towards zero. This could be due to the following reasons:
 - Not all the meters are digital and nor are all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually.
 - The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.