



ལྷན་ཁག་དང་ལས་ཁུངས་ཀྱི་འཛིན་སྐྱོང་གི་དཔལ་ལྷན་གྱི་འཛིན་སྐྱོང་།
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 27-Jun-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	June 26, 2026	9:00 AM			08-Nov-25	19:03:00
						1,477.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	80.67	400kV THP - Siliguri Line - I	65.41	Unit-V under Shutdown.
		Unit-II	83.94	400kV THP - Siliguri Line - II	63.38	
		Unit-III	120.04	400kV THP - Norbugang - IV	135.34	
		Unit-IV	120.54	400kV THP - Malbase Line - III	276.13	
		Unit-V	0.00	400kV Malbase - Siliguri Line	12.39	
		Unit-VI	140.24	400kV Norbugang-Siliguri Line	2.21	
		Total	545.43	Auxiliary Consumption & Transformation Losses at Generator end	0.95%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	60.24	400kV MHP - Jigmeling Line - I	163.43	400kV MHP-JLG line- II under Shutdown.
		Unit-II	140.29	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	150.76	400kV MHP - Jigmeling Line - III	169.53	
		Unit-IV	150.61	400kV MHP - Jigmeling Line - IV	169.17	
		-	-	220kV Jigmeling - BitDeer Line - I	198.51	
		-	-	220kV Jigmeling - BitDeer Line - II	179.38	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	435.27	
		-	-	400kV Jigmeling - Alipurdhar Line - I	145.46	
		-	-	400kV Jigmeling - Alipurdhar Line - II	144.73	
		-	-	80MVA, 220/132kV ICT - I (HV)	29.23	
		-	-	80MVA, 220/132kV ICT - II (HV)	28.84	
		-	-	132kV MHP - Yurmo Line - II	52.37	
		-	-	132kV MHP - Tintibi Line	40.77	
		-	-	132kV Gelephu - Salakati Line	-27.32	
		Total	501.90	Auxiliary Consumption & Transformation Losses at Generator end	0.20%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	132.00	400kV PHP II - Jigmeling - I	115.35	Unit-II under Shutdown.
		Unit-II	0.00	400kV PHP II - Jigmeling - II	114.38	
		Unit-III	132.65	400kV PHP II - Alipurdhar - I	206.21	
		Unit-IV	130.32	400kV PHP II - Alipurdhar - II	206.62	
		Unit-V	120.21	-	-	
		Unit-VI	128.37	-	-	
		Total	643.55	Auxiliary Consumption & Transformation Losses at Generator end	0.15%	
4	4 x 84 MW CHP (Chukha)	Unit-I	57.57	220kV CHP - Birpara Line - I	-20.57	All Units & Feeders are in Service.
		Unit-II	57.54	220kV CHP - Birpara Line - II	-20.39	
		Unit-III	91.24	220kV CHP - Gedu	43.55	
		Unit-IV	57.84	220kV CHP - Jamjee - I	86.11	
		-	-	220kV CHP - Jamjee - II	85.01	
		-	-	220kV CHP - Jamjee - III	82.30	
		-	-	220kV Malbase - Birpara Line	-25.24	
		-	-	66kV CHP - Gedu Line	6.69	
		Total	264.19	Auxiliary Consumption & Transformation Losses at Generator end	0.56%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	6.80	220kV BHP - Semtokha Line	41.24	All Units and Feeders are in Service.
		Unit-II	6.73	66kV BHP - Lobeysa Line	20.35	
		Total	13.53	220kV BHP - Tsirang Line	-21.55	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	13.50	5MVA, 66/11kV TFR	0.38	All Units and Feeders are in Service.
		Unit-II	13.68	30MVA ICT, 220/66kV (HV)	6.76	
		Total	27.18	Auxiliary Consumption & Transformation Losses at Generator end	0.71%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	37.15	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line & Unit-II on Standby.
		Unit-II	0.00	220kV DHP - Dagapela Line	36.80	
		-	-	220kV BitDeer - Dagapela Line	11.54	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	37.15	Auxiliary Consumption & Transformation Losses at Generator end	0.40%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.48	132kV KHP - Nangkhor Line	48.84	All Units and Feeders are in Service.
		Unit-II	16.50	132kV KHP - Kilikhar Line	16.16	
		Unit-III	16.52	5MVA, 132/11kV TFR	0.29	
		Unit-IV	16.63	132kV Motanga - Rangja Line	39.72	
		Total	66.13	Auxiliary Consumption & Transformation Losses at Generator end	1.27%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	50.08	132kV NHP-MHP-I	49.61	All Units and Feeders are in Service.
		Unit-II	45.03	132kV NHP-MHP-II	44.77	
		Total	95.11	Auxiliary Consumption & Transformation Losses at Generator end	0.77%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.05	66kV SHP-Damdhum (Samtse)	0.00	Interim measure: Evacuation is through 33kV System.
		Unit-II	5.02	-	-	
		Total	10.07	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	22.38 MWp SSP (Sephu Solar Plant)	Inverter-1	1.85	33kV SSP-Wangdue	3.55	All Inverters & Feeders are in Service.
		Inverter-2	0.86	33kV SSP-Trongsa	4.91	
		Inverter-3	0.84	-	-	
		Inverter-4	4.15	-	-	
		Inverter-5	0.75	-	-	
		Total	8.46	Auxiliary Consumption & Transformation Losses at Generator end	0.01%	
12	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	15.02	Unit-I under Shutdown.
		Unit-II	16.01	5MVA, 132/33kV TFR	0.76	
		Total	16.01	Auxiliary Consumption & Transformation Losses at Generator end	1.44%	
13	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	16.69	132kV BSHP-Panbang	18.02	All Units & Feeders are in Service.
		Unit-II	22.88	132kV BSHP-Tintibi	21.09	
		Total	39.57	Auxiliary Consumption & Transformation Losses at Generator end	1.16%	


Note: Generation-Load Summary (MW) for 26-Jun-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,268.28	1,475.68	792.61

Note: Generation-Load Summary (MW) for 26-Jun-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,598.52	941.22	657.30

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 27-Jun-2026(-ve:import,+ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	June 26, 2026	19:00:00			08-Nov-25	19:03:00
						1,477.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	100.69	400kV THP - Siliguri Line - I	72.19	Unit VI on Standby.
		Unit-II	114.93	400kV THP - Siliguri Line - II	70.58	
		Unit-III	130.06	400kV THP - Norbugang Line - IV	149.34	
		Unit-IV	120.48	400kV THP - Malbase Line - III	298.49	
		Unit-V	130.15	400kV Malbase - Siliguri Line	20.00	
		Unit-VI	0.00	400kV Norbugang-Siliguri Line	-9.45	
		Total	596.31	Auxiliary Consumption & Transformation Losses at Generator end	0.96%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	80.19	400kV MHP - Jigmeling Line - I	179.68	400kV MHP-JLG line- II under Shutdown.
		Unit-II	155.13	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	165.58	400kV MHP - Jigmeling Line - III	186.08	
		Unit-IV	150.64	400kV MHP - Jigmeling Line - IV	185.86	
		-	-	220kV Jigmeling - BitDeer Line - I	175.88	
		-	-	220kV Jigmeling - BitDeer Line - II	160.35	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	431.64	
		-	-	400kV Jigmeling - Alipurdwar Line - I	175.27	
		-	-	400kV Jigmeling - Alipurdwar Line - II	173.82	
		-	-	80MVA, 220/132kV ICT - I (HV)	48.38	
		-	-	80MVA, 220/132kV ICT - II (HV)	47.92	
		-	-	132kV MHP - Yumto Line - II	60.23	
		-	-	132kV MHP - Tintibi Line	24.01	
		-	-	132kV Gelephu - Salakati Line	-22.52	
		Total	551.54	Auxiliary Consumption & Transformation Losses at Generator end	-0.01%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	147.00	400kV PHP II - Jigmeling -I	118.82	Unit-II under Shutdown.
		Unit-II	0.00	400kV PHP II - Jigmeling -II	117.99	
		Unit-III	144.10	400kV PHP II - Alipurdwar -I	238.33	
		Unit-IV	136.30	400kV PHP II - Alipurdwar -II	238.84	
		Unit-V	139.70	-	-	
		Unit-VI	139.58	-	-	
		Total	706.68	Auxiliary Consumption & Transformation Losses at Generator end	-1.03%	
4	4 x 84 MW CHP (Chhukha)	Unit-I	69.53	220kV CHP - Birpara Line - I	-11.38	All Units & Feeders are in Service..
		Unit-II	69.32	220kV CHP - Birpara Line - II	-11.23	
		Unit-III	91.10	220kV CHP - Gedu	45.80	
		Unit-IV	63.71	220kV CHP - Jamjee - I	88.97	
		-	-	220kV CHP - Jamjee - II	88.37	
		-	-	220kV CHP - Jamjee - III	85.33	
		-	-	220kV Malbase - Birpara Line	-12.34	
		-	-	66kV CHP - Gedu Line	7.54	
		Total	293.66	Auxiliary Consumption & Transformation Losses at Generator end	0.09%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	6.45	220kV BHP - Sertokha Line	51.01	All Units and Feeders are in Service.
		Unit-II	7.90	66kV BHP - Lobeyssa Line	23.64	
		Total	14.35	220kV BHP - Tsirang Line	-32.81	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	14.16	5MVA, 66/11kV TFR	0.60	All Units and Feeders are in Service.
		Unit-II	14.00	30MVA ICT, 220/66kV (HV)	10.08	
		Total	28.16	Auxiliary Consumption & Transformation Losses at Generator end	0.16%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	0.00	220kV DHP - Tsirang Line	0.00	Unit-I under shutdown. 220kV DHP-Tsirang line on Standby.
		Unit-II	35.54	220kV DHP - Dagapela Line	34.90	
		-	-	220kV BitDeer - Dagapela Line	13.17	
		-	-	5MVA, 220/33kV TFR	0.30	
		Total	35.54	Auxiliary Consumption & Transformation Losses at Generator end	0.96%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.44	132kV KHP - Nangkor Line	45.35	All Units & Feeders are in Service.
		Unit-II	16.50	132kV KHP - Kilikhar Line	19.72	
		Unit-III	16.61	5MVA, 132/11kV TFR	0.37	
		Unit-IV	16.40	132kV Motanga - Rangla Line	48.62	
		Total	65.95	Auxiliary Consumption & Transformation Losses at Generator end	0.77%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	40.01	132kV NHP-MHP-I	39.62	Interim measure: Evacuation is through 33kV System.
		Unit-II	45.01	132kV NHP-MHP-II	44.65	
		Total	85.02	Auxiliary Consumption & Transformation Losses at Generator end	0.88%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.02	66kV SHP-Damdhum (Samtse)	0.00	Interim measure: Evacuation is through 33kV System.
		Unit-II	5.07	-	-	
		Total	10.09	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	14.45	Unit-I under Shutdown.
		Unit-II	16.00	5MVA, 132/33kV TFR	1.32	
		Total	16.00	Auxiliary Consumption & Transformation Losses at Generator end	1.44%	
12	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	21.84	132kV BSHP-Panbang	28.57	All Units & Feeders are in Service.
		Unit-II	14.16	132kV BSHP-Tintibi	7.02	
		Total	36.00	Auxiliary Consumption & Transformation Losses at Generator end	1.14%	

Note: Generation-Load Summary (MW) for 26-Jun-2026 at 18:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,439.30	1,468.57	970.73


Note: Generation-Load Summary (MW) for 26-Jun-2025, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	1,680.03	978.22	701.81

Note: Daily Energy (MUS) and Power(MW) Statistics for 26-Jun-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross- border (MW)
1	55.48	34.94	2.67	20.54	1,038.54

19:00 hrs Statistical Comparison
(MW) for this and last year

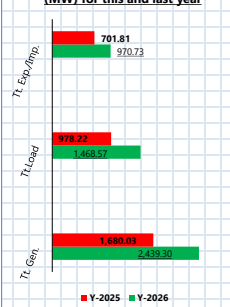

- The Instantaneous load balance does not tend towards zero. This could be due to the following reasons:
 - Not all the meters are digital and not all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually.
 - The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.