



ལྷན་ཁག་དང་ལོ་སྒྲིལ་གྱི་འཛུགས་ཁག་
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 12-Jul-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	July 11, 2026	9:00 AM			10-Jul-26	8:02:13
						1,584.59
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.82	400kV THP - Siliguri Line - I	225.97	All Units & Feeders are in Service.
		Unit-II	187.72	400kV THP - Siliguri Line - II	224.89	
		Unit-III	187.16	400kV THP - Norbugang - IV	246.62	
		Unit-IV	187.13	400kV THP - Malbase Line - III	417.20	
		Unit-V	186.93	400kV Malbase - Siliguri Line	164.52	
		Unit-VI	187.13	400kV Norbugang-Siliguri Line	91.16	
		Total	1,123.09	Auxiliary Consumption & Transformation Losses at Generator end	0.82%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	197.81	400kV MHP - Jigmeling Line - I	255.65	400kV MHP-JLG line- II under Shutdown.
		Unit-II	197.81	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	191.90	400kV MHP - Jigmeling Line - III	264.54	
		Unit-IV	198.29	400kV MHP - Jigmeling Line - IV	264.89	
		-	-	220kV Jigmeling - BitDeer Line - I	194.69	
		-	-	220kV Jigmeling - BitDeer Line - II	175.87	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	431.27	
		-	-	400kV Jigmeling - Alipurdhar Line - I	312.00	
		-	-	400kV Jigmeling - Alipurdhar Line - II	312.00	
		-	-	80MVA, 220/132kV ICT - I (HV)	31.01	
		-	-	80MVA, 220/132kV ICT - II (HV)	30.70	
		-	-	132kV MHP - Yurmo Line - II	50.61	
		-	-	132kV MHP - Tintibi Line	77.26	
		-	-	132kV Gelephu - Salakati Line	-13.52	
		Total	785.81	Auxiliary Consumption & Transformation Losses at Generator end	0.22%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	176.65	400kV PHP II - Jigmeling - I	140.86	All Units & Feeders are in Service.
		Unit-II	169.73	400kV PHP II - Jigmeling - II	140.00	
		Unit-III	189.28	400kV PHP II - Alipurdhar - I	390.32	
		Unit-IV	174.92	400kV PHP II - Alipurdhar - II	389.64	
		Unit-V	180.30	-	-	
		Unit-VI	175.28	-	-	
		Total	1,057.16	Auxiliary Consumption & Transformation Losses at Generator end	-0.35%	
4	4 x 84 MW CHP (Chukha)	Unit-I	91.58	220kV CHP - Birpara Line - I	18.08	All Units & Feeders are in Service.
		Unit-II	91.37	220kV CHP - Birpara Line - II	17.82	
		Unit-III	88.92	220kV CHP - Gedu	91.63	
		Unit-IV	91.73	220kV CHP - Jamjee - I	76.39	
		-	-	220kV CHP - Jamjee - II	75.86	
		-	-	220kV CHP - Jamjee - III	73.26	
		-	-	220kV Malbase - Birpara Line	2.16	
		-	-	66kV CHP - Gedu Line	8.56	
		Total	363.60	Auxiliary Consumption & Transformation Losses at Generator end	0.55%	
5	2 x 12 MW BHP (U/S) (Basochu)	Unit-I	10.79	220kV BHP - Semtokha Line	61.23	All Units & Feeders are in Service.
		Unit-II	8.21	66kV BHP - Lobeysa Line	21.17	
		Total	19.00	220kV BHP - Tsirang Line	-26.31	
6	2 x 20 MW BHP (L/S) (Basochu)	Unit-I	18.46	5MVA, 66/11kV TFR	0.31	All Units & Feeders are in Service.
		Unit-II	18.46	30MVA ICT, 220/66kV (HV)	1.01	
		Total	36.92	Auxiliary Consumption & Transformation Losses at Generator end	-0.86%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	34.44	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang on Standby
		Unit-II	30.06	220kV DHP - Dagapela Line	64.10	
		-	-	220kV BitDeer - Dagapela Line	-18.70	
		-	-	5MVA, 220/33kV TFR	0.21	
		Total	64.50	Auxiliary Consumption & Transformation Losses at Generator end	0.29%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.15	132kV KHP - Nangkor Line	47.89	All Units and Feeders are in Service.
		Unit-II	16.45	132kV KHP - Kilikhar Line	16.98	
		Unit-III	16.49	5MVA, 132/11kV TFR	0.34	
		Unit-IV	16.60	132kV Motanga - Rangja Line	53.23	
		Total	65.69	Auxiliary Consumption & Transformation Losses at Generator end	0.73%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	64.87	132kV NHP-MHP-I	64.40	All Units & Feeders are in Service.
		Unit-II	64.93	132kV NHP-MHP-II	64.46	
		Total	129.80	Auxiliary Consumption & Transformation Losses at Generator end	0.72%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.02	66kV SHP-Damdhum (Samtse)	0.00	Power Evacuation is through 33kV feeder.
		Unit-II	5.06	-	-	
		Total	10.08	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	22.38 MWp SSP (Sephu Solar Plant)	Inverter-1	1.70	33kV SSP-Wangdue	6.25	All inverters and Feeder in service
		Inverter-2	2.65	33kV SSP-Trongsa	5.31	
		Inverter-3	1.98	-	-	
		Inverter-4	3.11	-	-	
		Inverter-5	2.13	-	-	
		Total	11.57	Auxiliary Consumption & Transformation Losses at Generator end	0.09%	
12	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	15.26	Unit-I under Shutdown.
		Unit-II	16.16	5MVA, 132/33kV TFR	0.66	
		Total	16.16	Auxiliary Consumption & Transformation Losses at Generator end	1.49%	
13	2 x 27 MW BSHP (Burgangchhu Small HPP)	Unit-I	0.00	132kV BSHP-Panbang	28.12	Unit I under Shutdown.
		Unit-II	27.16	132kV BSHP-Tintibi	-1.32	
		Total	27.16	Auxiliary Consumption & Transformation Losses at Generator end	1.33%	


Note: Generation-Load Summary (MW) for 11-Jul-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,710.54	1,523.07	2,187.47

Note: Generation-Load Summary (MW) for 11-Jul-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,432.35	955.22	1,477.13

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 12-Jul-2026(+ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	July 11, 2026	19:00:00			10-Jul-26	8:02:13
						1,584.59
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.04	400kV THP - Siliguri Line - I	215.09	All Feeders & Units are in Service.
		Unit-II	187.70	400kV THP - Siliguri Line - II	213.82	
		Unit-III	187.12	400kV THP - Norbugang Line - IV	246.94	
		Unit-IV	186.99	400kV THP - Malbase Line - III	437.39	
		Unit-V	186.87	400kV Malbase - Siliguri Line	154.00	
		Unit-VI	187.13	400kV Norbugang-Siliguri Line	91.43	
		Total	1,122.85	Auxiliary Consumption & Transformation Losses at Generator end	0.86%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	188.18	400kV MHP - Jigmeling Line - I	249.35	400kV MHP-JLG line - II under Shutdown.
		Unit-II	187.91	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	191.56	400kV MHP - Jigmeling Line - III	257.82	
		Unit-IV	198.40	400kV MHP - Jigmeling Line - IV	257.95	
		-	-	220kV Jigmeling - BitDeer Line - I	186.08	
		-	-	220kV Jigmeling - BitDeer Line - II	168.34	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	420.73	
		-	-	400kV Jigmeling - Alipurdur Line - I	304.00	
		-	-	400kV Jigmeling - Alipurdur Line - II	303.27	
		-	-	80MVA, 220/132kV ICT - I (HV)	34.39	
		-	-	80MVA, 220/132kV ICT - II (HV)	34.07	
		-	-	132kV MHP - Yumo Line - II	55.75	
		-	-	132kV MHP - Tintibi Line	59.02	
		-	-	132kV Gelephu - Salakati Line	1.83	
		Total	766.05	Auxiliary Consumption & Transformation Losses at Generator end	0.33%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	172.84	400kV PHP II - Jigmeling -I	139.24	All Units & Feeders are in Service.
		Unit-II	166.41	400kV PHP II - Jigmeling -II	138.60	
		Unit-III	176.68	400kV PHP II - Alipurdur -I	381.30	
		Unit-IV	172.11	400kV PHP II - Alipurdur -II	380.58	
		Unit-V	176.68	-	-	
		Unit-VI	171.40	-	-	
		Total	1,036.12	Auxiliary Consumption & Transformation Losses at Generator end	-0.35%	
4	4 x 84 MW CHP (Chhukha)	Unit-I	91.58	220kV CHP - Birpara Line - I	20.71	All Units & Feeder are in Service.
		Unit-II	91.37	220kV CHP - Birpara Line - II	20.97	
		Unit-III	88.92	220kV CHP - Gedu	77.33	
		Unit-IV	91.73	220kV CHP - Jamjee - I	78.83	
		-	-	220kV CHP - Jamjee - II	78.24	
		-	-	220kV CHP - Jamjee - III	75.37	
		-	-	220kV Malbase - Birpara Line	11.04	
		-	-	66kV CHP - Gedu Line	8.76	
		Total	363.60	Auxiliary Consumption & Transformation Losses at Generator end	0.93%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	11.88	220kV BHP - Semtokha Line	67.92	All Units and Feeders are in Service.
		Unit-II	11.72	66kV BHP - Lobeysa Line	26.51	
		Total	23.60	220kV BHP - Tsirang Line	-30.35	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	28.41	5MVA, 66/11kV TFR	0.62	
		Unit-II	28.63	30MVA ICT, 220/66kV (HV)	3.57	
		Total	41.04	Auxiliary Consumption & Transformation Losses at Generator end	-0.09%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	0.00	220kV DHP - Tsirang Line	0.00	Unit -I on Standby. 220kV DHP-Tsirang on Standby
		Unit-II	60.06	220kV DHP - Dagapela Line	59.66	
		-	-	220kV BitDeer - Dagapela Line	-12.33	
		-	-	5MVA, 220/33kV TFR	0.22	
		Total	60.06	Auxiliary Consumption & Transformation Losses at Generator end	0.30%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.25	132kV KHP - Nangkor Line	51.16	All Units & Feeders are in Service.
		Unit-II	16.52	132kV KHP - Kilikhar Line	13.75	
		Unit-III	16.40	5MVA, 132/11kV TFR	0.37	
		Unit-IV	16.69	132kV Motanga - Rangla Line	11.92	
		Total	65.86	Auxiliary Consumption & Transformation Losses at Generator end	0.88%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	52.30	132kV NHP-MHP-I	51.93	All Units & Feeders are in Service.
		Unit-II	64.90	132kV NHP-MHP-II	64.43	
		Total	117.20	Auxiliary Consumption & Transformation Losses at Generator end	0.72%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	5.02	66kV SHP-Damdhum (Samtse)	0.00	66kV SHP-SAM Idle Charged at 19:00 hrs
		Unit-II	5.05	-	-	
		Total	10.07	Auxiliary Consumption & Transformation Losses at Generator end	100.00%	
11	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	14.36	Unit-I under Shutdown.
		Unit-II	16.16	5MVA, 132/33kV TFR	1.55	
		Total	16.16	Auxiliary Consumption & Transformation Losses at Generator end	1.55%	
12	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	0.00	132kV BSHP-Panbang	0.00	Unit-I under Shutdown.
		Unit-II	27.23	132kV BSHP-Tintibi	26.88	
		Total	27.23	Auxiliary Consumption & Transformation Losses at Generator end	1.29%	

Note: Generation-Load Summary (MW) for 11-Jul-2026 at 18:00 hrs


Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,649.84	1,539.88	2,109.96

Note: Generation-Load Summary (MW) for 11-Jul-2025, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,531.06	990.07	1,540.99

Note: Daily Energy (MUS) and Power(MW) Statistics for 11-Jul-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross- border (MW)
1	87.28	35.78	0.00	51.46	2,249.25

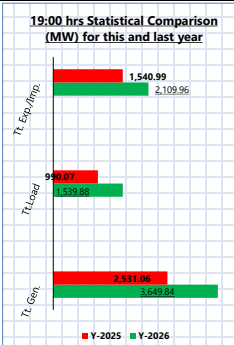

1. The instantaneous load balance does not tend towards zero. This could be due to the following reasons:

- Not all the meters are digital and not all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually. ii) The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.