



ལྷན་ཁག་དང་ལས་ཁུངས་ཀྱི་འཛིན་སྐྱོང་གི་དཔལ་ལྷན་གྱི་འཛིན་སྐྱོང་།
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 18-Aug-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	August 18, 2026	9:00 AM			06-Aug-26	19:11:47
						1,615.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.47	400kV THP - Siliguri Line - I	181.33	All Units and Feeders are in Service.
		Unit-II	100.36	400kV THP - Siliguri Line - II	179.55	
		Unit-III	120.00	400kV THP - Norbugang - IV	207.74	
		Unit-IV	146.36	400kV THP - Malbase Line - III	352.50	
		Unit-V	186.94	400kV Malbase - Siliguri Line	128.24	
		Unit-VI	187.12	400kV Norbugang-Siliguri Line	76.47	
		Total	928.85	Auxiliary Consumption & Transformation Losses at Generator end	0.83%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	197.21	400kV MHP - Jigmeling Line - I	264.10	400kV MHP-JLG Line -III on Standby.
		Unit-II	197.14	400kV MHP - Jigmeling Line - II	263.32	
		Unit-III	191.08	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	198.11	400kV MHP - Jigmeling Line - IV	256.92	
		-	-	220kV Jigmeling - BitDeer Line - I	178.66	
		-	-	220kV Jigmeling - BitDeer Line - II	162.34	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	428.36	
		-	-	400kV Jigmeling - Alipurduar Line - I	283.64	
		-	-	400kV Jigmeling - Alipurduar Line - II	284.36	
		-	-	80MVA, 220/132kV ICT - I (HV)	43.35	
		-	-	80MVA, 220/132kV ICT - II (HV)	42.93	
		-	-	132kV MHP - Yurmo Line - II	50.27	
		-	-	132kV MHP - Tintibi Line	-10.04	
		-	-	132kV Gelephu - Salakati Line	-35.65	
		Total	783.54	Auxiliary Consumption & Transformation Losses at Generator end	2.99%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	181.19	400kV PHP II - Jigmeling -I	109.45	Unit-V under Shutdown.
		Unit-II	176.48	400kV PHP II - Jigmeling -II	109.07	
		Unit-III	183.61	400kV PHP II - Alipurduar -I	345.72	
		Unit-IV	179.96	400kV PHP II - Alipurduar -II	345.20	
		Unit-V	0.00	-	-	
		Unit-VI	183.55	-	-	
		Total	904.79	Auxiliary Consumption & Transformation Losses at Generator end	-0.51%	
4	4 x 84 MW CHP (Chukha)	Unit-I	91.53	220kV CHP - Birpara Line - I	13.88	All Units and Feeders are in Service.
		Unit-II	91.28	220kV CHP - Birpara Line - II	13.81	
		Unit-III	91.27	220kV CHP - Gedu	114.89	
		Unit-IV	91.28	220kV CHP - Jamjee - I	72.62	
		-	-	220kV CHP - Jamjee - II	72.04	
		-	-	220kV CHP - Jamjee - III	69.28	
		-	-	220kV Malbase - Birpara Line	-24.91	
		-	-	66kV CHP - Gedu Line	7.36	
		Total	365.36	Auxiliary Consumption & Transformation Losses at Generator end	0.41%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	11.96	220kV BHP - Semtokha Line	67.76	All Units & Feeders are in Service.
		Unit-II	11.36	66kV BHP - Lobeysa Line	22.15	
		Total	23.32	220kV BHP - Tsirang Line	-25.21	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	20.49	5MVA, 66/11kV TFR	0.36	All Units & Feeders are in Service.
		Unit-II	20.60	30MVA ICT, 220/66kV (HV)	-1.11	
		Total	41.09	Auxiliary Consumption & Transformation Losses at Generator end	-1.01%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	43.54	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line on Standby.
		Unit-II	41.53	220kV DHP - Dagapela Line	85.01	
		-	-	220kV BitDeer - Dagapela Line	-40.86	
		-	-	5MVA, 220/33kV TFR	0.22	
		Total	85.07	Auxiliary Consumption & Transformation Losses at Generator end	-0.19%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.47	132kV KHP - Nangkor Line	52.39	All Units & Feeders are in Service.
		Unit-II	16.64	132kV KHP - Kilikhar Line	12.88	
		Unit-III	16.27	5MVA, 132/11kV TFR	0.39	
		Unit-IV	16.48	132kV Motanga - Rangja Line	36.78	
		Total	65.86	Auxiliary Consumption & Transformation Losses at Generator end	0.30%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	0.00	132kV NHP-MHP-I	0.00	Unit-I under Shutdown.
		Unit-II	64.94	132kV NHP-MHP-II	64.49	
		Total	64.94	Auxiliary Consumption & Transformation Losses at Generator end	0.69%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	8.09	66kV SHP-Damdhum (Samtse)	14.62	SHP unit-I under shutdown.
		Unit-II	6.68	-	-	
		Total	14.77	Auxiliary Consumption & Transformation Losses at Generator end	1.02%	
11	22.38 MWp SSP (Sephu Solar Plant)	Inverter-1	2.12	33kV SSP-Wangdue	7.16	All Inverters and Feeders in Service
		Inverter-2	1.74	33kV SSP-Trongsa	7.37	
		Inverter-3	3.31	-	-	
		Inverter-4	3.98	-	-	
		Inverter-5	3.40	-	-	
		Total	14.55	Auxiliary Consumption & Transformation Losses at Generator end	0.10%	
12	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	15.10	Unit-I under Shutdown.
		Unit-II	16.02	5MVA, 132/33kV TFR	0.67	
		Total	16.02	Auxiliary Consumption & Transformation Losses at Generator end	1.56%	
13	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	27.35	132kV BSHP-Panbang	43.50	All Units & Feeders are in Service.
		Unit-II	27.09	132kV BSHP-Tintibi	10.38	
		Total	54.44	Auxiliary Consumption & Transformation Losses at Generator end	1.03%	


Note: Generation-Load Summary (MW) for 18-Aug-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,362.60	1,534.18	1,828.42

Note: Generation-Load Summary (MW) for 18-Aug-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,386.71	1,086.53	2,300.18

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 18-Aug-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	August 17, 2026	19:00:00			06-Aug-26	19:11:47
						1,615.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	186.53	400kV THP - Siliguri Line - I	176.60	All Units & Feeders are in Service.
		Unit-II	145.88	400kV THP - Siliguri Line - II	175.07	
		Unit-III	145.06	400kV THP - Norbugang Line - IV	217.75	
		Unit-IV	126.93	400kV THP - Malbase Line - III	400.99	
		Unit-V	186.97	400kV Malbase - Siliguri Line	112.13	
		Unit-VI	187.28	400kV Norbugang-Siliguri Line	65.90	
		Total	978.65	Auxiliary Consumption & Transformation Losses at Generator end	0.84%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	58.17	400kV MHP - Jigmeling Line - I	185.52	400kV MHP-JLG Line -III on Standby.
		Unit-II	150.20	400kV MHP - Jigmeling Line - II	184.87	
		Unit-III	146.20	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	197.15	400kV MHP - Jigmeling Line - IV	180.51	
		-	-	220kV Jigmeling - BitDeer Line - I	148.25	
		-	-	220kV Jigmeling - BitDeer Line - II	136.51	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	428.00	
		-	-	400kV Jigmeling - Alipurdwar Line - I	213.09	
		-	-	400kV Jigmeling - Alipurdwar Line - II	211.64	
		-	-	80MVA, 220/132kV ICT - I (HV)	72.39	
		-	-	80MVA, 220/132kV ICT - II (HV)	71.75	
		-	-	132kV MHP - Yumo Line - II	58.14	
		-	-	132kV MHP - Tintibi Line	-58.15	
		-	-	132kV Gelephu - Salakati Line	-32.32	
		Total	551.72	Auxiliary Consumption & Transformation Losses at Generator end	0.15%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	181.76	400kV PHP II - Jigmeling -I	155.85	Unit V under Shutdown.
		Unit-II	174.29	400kV PHP II - Jigmeling -II	155.10	
		Unit-III	183.14	400kV PHP II - Alipurdwar -I	296.14	
		Unit-IV	179.87	400kV PHP II - Alipurdwar -II	296.25	
		Unit-V	0.00	-	-	
		Unit-VI	179.75	-	-	
		Total	898.81	Auxiliary Consumption & Transformation Losses at Generator end	-0.50%	
4	4 x 84 MW CHP (Chhukha)	Unit-I	91.36	220kV CHP - Birpara Line - I	16.23	All Units & Feeders are in Service.
		Unit-II	91.40	220kV CHP - Birpara Line - II	16.02	
		Unit-III	91.47	220kV CHP - Gedu	68.75	
		Unit-IV	91.27	220kV CHP - Jamjee - I	86.93	
		-	-	220kV CHP - Jamjee - II	86.54	
		-	-	220kV CHP - Jamjee - III	83.29	
		-	-	220kV Malbase - Birpara Line	14.14	
		-	-	66kV CHP - Gedu Line	5.96	
		Total	365.50	Auxiliary Consumption & Transformation Losses at Generator end	0.49%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	12.01	220kV BHP - Semtokha Line	51.00	All Units & Feeders are in Service.
		Unit-II	9.21	66kV BHP - Lobeysa Line	27.02	
		Total	21.22	220kV BHP - Tsirang Line	-16.69	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	20.48	5MVA, 66/11kV TFR	0.67	All Units & Feeders are in Service.
		Unit-II	20.57	30MVA ICT, 220/66kV (HV)	4.83	
		Total	41.05	Auxiliary Consumption & Transformation Losses at Generator end	0.43%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	38.48	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line on Standby.
		Unit-II	36.05	220kV DHP - Dagapela Line	74.00	
		-	-	220kV BitDeer - Dagapela Line	-17.00	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	74.53	Auxiliary Consumption & Transformation Losses at Generator end	0.44%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.43	132kV KHP - Nangkor Line	49.79	All Units & Feeders are in Service.
		Unit-II	16.52	132kV KHP - Kilikhar Line	14.86	
		Unit-III	16.32	5MVA, 132/11kV TFR	0.46	
		Unit-IV	16.58	132kV Motanga - Rangla Line	19.52	
		Total	65.85	Auxiliary Consumption & Transformation Losses at Generator end	1.12%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	0.00	132kV NHP-MHP-I	0.00	NHP total plant shutdown for DAM scouring.
		Unit-II	0.00	132kV NHP-MHP-II	0.00	
		Total	0.00	Auxiliary Consumption & Transformation Losses at Generator end	0.00%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	8.39	66kV SHP-Damdhum (Samtse)	14.73	All Units and Feeders are in Service.
		Unit-II	6.50	-	-	
		Total	14.89	Auxiliary Consumption & Transformation Losses at Generator end	1.07%	
11	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	13.99	Unit-I under Shutdown.
		Unit-II	16.02	5MVA, 132/33kV TFR	1.78	
		Total	16.02	Auxiliary Consumption & Transformation Losses at Generator end	1.56%	
12	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	27.08	132kV BSHP-Panbang	38.70	All Units & Feeders are in Service.
		Unit-II	26.43	132kV BSHP-Tintibi	14.23	
		Total	53.51	Auxiliary Consumption & Transformation Losses at Generator end	1.08%	

Note: Generation-Load Summary (MW) for 17-Aug-2026 at 18:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,081.75	1,501.34	1,580.41


Note: Generation-Load Summary (MW) for 17-Aug-2025, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,384.40	1,099.65	2,284.75

Note: Daily Energy (MUS) and Power(MW) Statistics for 17-Aug-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross- border (MW)
1	76.58	35.56	0.00	41.01	2,140.86

19:00 hrs Statistical Comparison
(MW) for this and last year

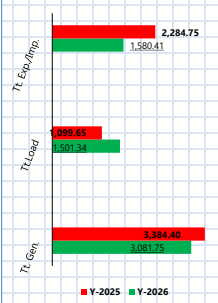

- The instantaneous load balance does not tend towards zero. This could be due to the following reasons:
 - Not all the meters are digital and not all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually.
 - The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.