



ལྷན་ཁག་དང་ལོ་ལོ་མཉམ་ནས་འཕུལ་གྱིན་པའི་ལྷན་ཁག་
Ministry of Energy and Natural Resources
Royal Government of Bhutan
Bhutan Power System Operator
Thimphu: Bhutan



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 19-Aug-2026(-ve:import, +ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	August 19, 2026	9:00 AM			06-Aug-26	19:11:47
						1,615.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	185.53	400kV THP - Siliguri Line - I	224.77	All Units and Feeders are in Service.
		Unit-II	185.70	400kV THP - Siliguri Line - II	222.92	
		Unit-III	185.04	400kV THP - Norbugang - IV	244.17	
		Unit-IV	185.92	400kV THP - Malbase Line - III	422.03	
		Unit-V	185.97	400kV Malbase - Siliguri Line	160.98	
		Unit-VI	185.26	400kV Norbugang-Siliguri Line	102.00	
		Total	1,113.42	Auxiliary Consumption & Transformation Losses at Generator end	-0.04%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	197.76	400kV MHP - Jigmeling Line - I	264.81	400kV MHP-JLG Line -III on Standby.
		Unit-II	197.74	400kV MHP - Jigmeling Line - II	264.22	
		Unit-III	194.04	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	197.49	400kV MHP - Jigmeling Line - IV	257.69	
		-	-	220kV Jigmeling - BitDeer Line - I	188.15	
		-	-	220kV Jigmeling - BitDeer Line - II	170.26	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	428.73	
		-	-	400kV Jigmeling - Alipurduar Line - I	312.73	
		-	-	400kV Jigmeling - Alipurduar Line - II	312.00	
		-	-	80MVA, 220/132kV ICT - I (HV)	35.89	
		-	-	80MVA, 220/132kV ICT - II (HV)	35.54	
		-	-	132kV MHP - Yurmo Line - II	49.07	
		-	-	132kV MHP - Tintibi Line	58.22	
		-	-	132kV Gelephu - Salakati Line	-15.16	
		Total	787.03	Auxiliary Consumption & Transformation Losses at Generator end	0.29%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	185.57	400kV PHP II - Jigmeling -I	138.48	All Units and Feeders are in Service.
		Unit-II	178.07	400kV PHP II - Jigmeling -II	137.54	
		Unit-III	183.76	400kV PHP II - Alipurduar -I	389.13	
		Unit-IV	179.12	400kV PHP II - Alipurduar -II	388.28	
		Unit-V	149.69	-	-	
		Unit-VI	179.73	-	-	
		Total	1,055.94	Auxiliary Consumption & Transformation Losses at Generator end	0.24%	
4	4 x 84 MW CHP (Chukha)	Unit-I	92.31	220kV CHP - Birpara Line - I	21.54	All Units and Feeders are in Service.
		Unit-II	92.41	220kV CHP - Birpara Line - II	21.01	
		Unit-III	91.39	220kV CHP - Gedu	107.74	
		Unit-IV	91.36	220kV CHP - Jamjee - I	69.88	
		-	-	220kV CHP - Jamjee - II	69.13	
		-	-	220kV CHP - Jamjee - III	66.74	
		-	-	220kV Malbase - Birpara Line	-7.54	
		-	-	66kV CHP - Gedu Line	8.47	
		Total	367.47	Auxiliary Consumption & Transformation Losses at Generator end	0.81%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	10.88	220kV BHP - Semtokha Line	68.79	All Units & Feeders are in Service.
		Unit-II	9.95	66kV BHP - Lobeysa Line	21.43	
		Total	20.83	220kV BHP - Tsirang Line	-27.68	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	20.48	5MVA, 66/11kV TFR	0.29	All Units & Feeders are in Service.
		Unit-II	20.45	30MVA ICT, 220/66kV (HV)	-0.18	
		Total	40.93	Auxiliary Consumption & Transformation Losses at Generator end	-1.73%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	39.98	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line on Standby.
		Unit-II	40.01	220kV DHP - Dagapela Line	79.00	
		-	-	220kV BitDeer - Dagapela Line	-34.99	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	79.99	Auxiliary Consumption & Transformation Losses at Generator end	0.99%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.50	132kV KHP - Nangkor Line	51.92	All Units & Feeders are in Service.
		Unit-II	16.47	132kV KHP - Kilikhar Line	13.26	
		Unit-III	16.58	5MVA, 132/11kV TFR	0.36	
		Unit-IV	16.43	132kV Motanga - Rangja Line	41.16	
		Total	65.98	Auxiliary Consumption & Transformation Losses at Generator end	0.67%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	44.99	132kV NHP-MHP-I	44.75	All Units & Feeders are in Service.
		Unit-II	65.05	132kV NHP-MHP-II	64.51	
		Total	110.04	Auxiliary Consumption & Transformation Losses at Generator end	0.71%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	7.49	66kV SHP-Damdhum (Samtse)	15.12	All Units & Feeders are in Service.
		Unit-II	7.79	-	-	
		Total	15.28	Auxiliary Consumption & Transformation Losses at Generator end	1.05%	
11	22.38 MWp SSP (Sephu Solar Plant)	Inverter-1	1.81	33kV SSP-Wangdue	8.06	All Inverters and Feeders in Service
		Inverter-2	3.17	33kV SSP-Trongsa	7.40	
		Inverter-3	3.08	-	-	
		Inverter-4	4.01	-	-	
		Inverter-5	3.36	-	-	
		Total	15.44	Auxiliary Consumption & Transformation Losses at Generator end	-0.16%	
12	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	15.03	Unit-I under Shutdown.
		Unit-II	16.02	5MVA, 132/33kV TFR	0.73	
		Total	16.02	Auxiliary Consumption & Transformation Losses at Generator end	1.62%	
13	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	27.06	132kV BSHP-Panbang	50.07	All Units & Feeders are in Service.
		Unit-II	26.80	132kV BSHP-Tintibi	3.14	
		Total	53.86	Auxiliary Consumption & Transformation Losses at Generator end	1.21%	


Note: Generation-Load Summary (MW) for 19-Aug-26 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,742.23	1,568.41	2,173.82

Note: Generation-Load Summary (MW) for 19-Aug-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,602.03	1,034.27	1,567.76

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 19-Aug-2026(-ve:import,+ve:export)						
Report Details	Date	Time	National Coincidental Peak Load (MW)		Date	Time
	August 18, 2026	19:00:00			06-Aug-26	19:11:47
						1,615.00
Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170 MW THP (Tala)	Unit-I	187.55	400kV THP - Siliguri Line - I	183.60	All Units & Feeders are in Service.
		Unit-II	181.72	400kV THP - Siliguri Line - II	182.27	
		Unit-III	120.26	400kV THP - Norbugang Line - IV	224.18	
		Unit-IV	145.37	400kV THP - Malbase Line - III	409.53	
		Unit-V	186.88	400kV Malbase - Siliguri Line	118.10	
		Unit-VI	187.11	400kV Norbugang-Siliguri Line	69.88	
		Total	1,008.89	Auxiliary Consumption & Transformation Losses at Generator end	0.92%	
2	4 x 180 MW MHP (Mangdechhu)	Unit-I	196.83	400kV MHP - Jigmeling Line - I	262.05	400kV MHP-JLG Line -III on Standby.
		Unit-II	195.82	400kV MHP - Jigmeling Line - II	261.41	
		Unit-III	189.97	400kV MHP - Jigmeling Line - III	0.00	
		Unit-IV	197.68	400kV MHP - Jigmeling Line - IV	255.21	
		-	-	220kV Jigmeling - BitDeer Line - I	168.15	
		-	-	220kV Jigmeling - BitDeer Line - II	153.36	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	430.55	
		-	-	400kV Jigmeling - Aliparduar Line - I	280.73	
		-	-	400kV Jigmeling - Aliparduar Line - II	280.73	
		-	-	80MVA, 220/132kV ICT - I (HV)	54.95	
		-	-	80MVA, 220/132kV ICT - II (HV)	54.43	
		-	-	132kV MHP - Yumo Line - II	58.47	
		-	-	132kV MHP - Tintibi Line	44.20	
		-	-	132kV Gelephu - Salakati Line	-11.76	
		Total	780.30	Auxiliary Consumption & Transformation Losses at Generator end	0.39%	
3	6 x 170 MW PHP-II (Punatsangchhu)	Unit-I	185.57	400kV PHP II - Jigmeling -I	111.69	Unit V under Shutdown.
		Unit-II	172.93	400kV PHP II - Jigmeling -II	110.83	
		Unit-III	185.61	400kV PHP II - Aliparduar -I	343.56	
		Unit-IV	184.23	400kV PHP II - Aliparduar -II	343.13	
		Unit-V	0.00	-	-	
		Unit-VI	179.43	-	-	
		Total	907.77	Auxiliary Consumption & Transformation Losses at Generator end	-0.16%	
4	4 x 84 MW CHP (Chhukha)	Unit-I	91.40	220kV CHP - Birpara Line - I	20.41	All Units & Feeders are in Service.
		Unit-II	91.28	220kV CHP - Birpara Line - II	20.07	
		Unit-III	91.41	220kV CHP - Gedu	75.45	
		Unit-IV	91.39	220kV CHP - Jamjee - I	81.88	
		-	-	220kV CHP - Jamjee - II	80.80	
		-	-	220kV CHP - Jamjee - III	78.07	
		-	-	220kV Malbase - Birpara Line	15.68	
		-	-	66kV CHP - Gedu Line	7.11	
		Total	365.48	Auxiliary Consumption & Transformation Losses at Generator end	0.46%	
5	2 x 12 MW BHP (U/S) (Basochhu)	Unit-I	11.11	220kV BHP - Semtokha Line	68.20	All Units & Feeders are in Service.
		Unit-II	9.79	66kV BHP - Lobeysa Line	27.60	
		Total	20.90	220kV BHP - Tsirang Line	-34.91	
6	2 x 20 MW BHP (L/S) (Basochhu)	Unit-I	20.49	5MVA, 66/11kV TFR	0.71	
		Unit-II	20.58	30MVA ICT, 220/66kV (HV)	5.57	
		Total	41.07	Auxiliary Consumption & Transformation Losses at Generator end	0.60%	
7	2 x 63 MW DHP (Dagachhu)	Unit-I	42.52	220kV DHP - Tsirang Line	0.00	220kV DHP-Tsirang line on Standby.
		Unit-II	42.01	220kV DHP - Dagapela Line	83.90	
		-	-	220kV BitDeer - Dagapela Line	-27.00	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	84.53	Auxiliary Consumption & Transformation Losses at Generator end	0.51%	
8	4 x 15 MW KHP (Kurichhu)	Unit-I	16.49	132kV KHP - Nangkhor Line	48.18	All Units & Feeders are in Service.
		Unit-II	16.52	132kV KHP - Kilikhar Line	16.99	
		Unit-III	16.54	5MVA, 132/11kV TFR	0.46	
		Unit-IV	16.53	132kV Motanga - Rangla Line	52.11	
		Total	66.08	Auxiliary Consumption & Transformation Losses at Generator end	0.68%	
9	2 x 59 MW NHP (Nikachhu)	Unit-I	40.06	132kV NHP-MHP-I	39.73	All feeders and Units are in Service.
		Unit-II	64.90	132kV NHP-MHP-II	64.39	
		Total	104.96	Auxiliary Consumption & Transformation Losses at Generator end	0.80%	
10	2 x 9 MW SHP (Suchhu)	Unit-I	8.50	66kV SHP-Damdhum (Samtse)	16.82	All Units and Feeders are in Service.
		Unit-II	8.50	-	-	
		Total	17.00	Auxiliary Consumption & Transformation Losses at Generator end	1.06%	
11	2 x 16 MW YHP (Yungichhu)	Unit-I	0.00	132kV YHP-Kilikhar	14.02	Unit-I under Shutdown.
		Unit-II	16.03	5MVA, 132/33kV TFR	1.75	
		Total	16.03	Auxiliary Consumption & Transformation Losses at Generator end	1.62%	
12	2 x 27 MW BSHP (Burgangchhu Small HP)	Unit-I	27.26	132kV BSHP-Panbang	67.54	All Units & Feeders are in Service.
		Unit-II	26.13	132kV BSHP-Tintibi	-14.68	
		Total	53.39	Auxiliary Consumption & Transformation Losses at Generator end	0.99%	

Note: Generation-Load Summary (MW) for 18-Aug-2026 at 18:00 hrs


Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,466.40	1,567.90	1,898.51

Note: Generation-Load Summary (MW) for 18-Aug-2025, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,309.92	1,105.63	2,204.29

Note: Daily Energy (MUS) and Power(MW) Statistics for 18-Aug-2026

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross- border (MW)
1	81.02	36.38	0.00	44.65	2,007.56

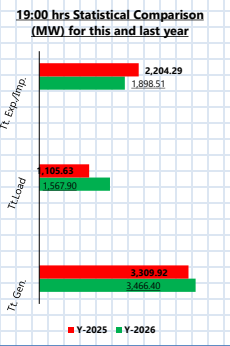

1. The instantaneous load balance does not tend towards zero. This could be due to the following reasons:

- Not all the meters are digital and not all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually. ii) The clocks of all the locations are not synchronized.
- This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
- When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.